


6 System piping *(continued)*

Figure 6-6 Double Appliance - Double Tank

Model	Standard Pump							Model	Upsized Pump						
	Number of Units								Number of Units						
	2	3	4	5	6	7	8		2	3	4	5	6	7	8
	Required Pipe Sizes in NPT with Standard Pump								Required Pipe Sizes in NPT with Upsized Pump						
1250	4"	5"	6"	6"	7"	7"	8"	1250	5"	6"	7"	7"	8"	9"	9"
1500	4"	5"	6"	6"	7"	7"	8"	1500	5"	6"	7"	7"	8"	9"	9"
2000	5"	6"	7"	7"	8"	9"	9"	2000	5"	6"	7"	8"	9"	10"	10"
3000	6"	8"	9"	10"	11"	12"	12"	3000	6"	8"	9"	10"	11"	12"	12"
4000	7"	8"	9"	10"	11"	12"	13"	4000	Contact Factory						

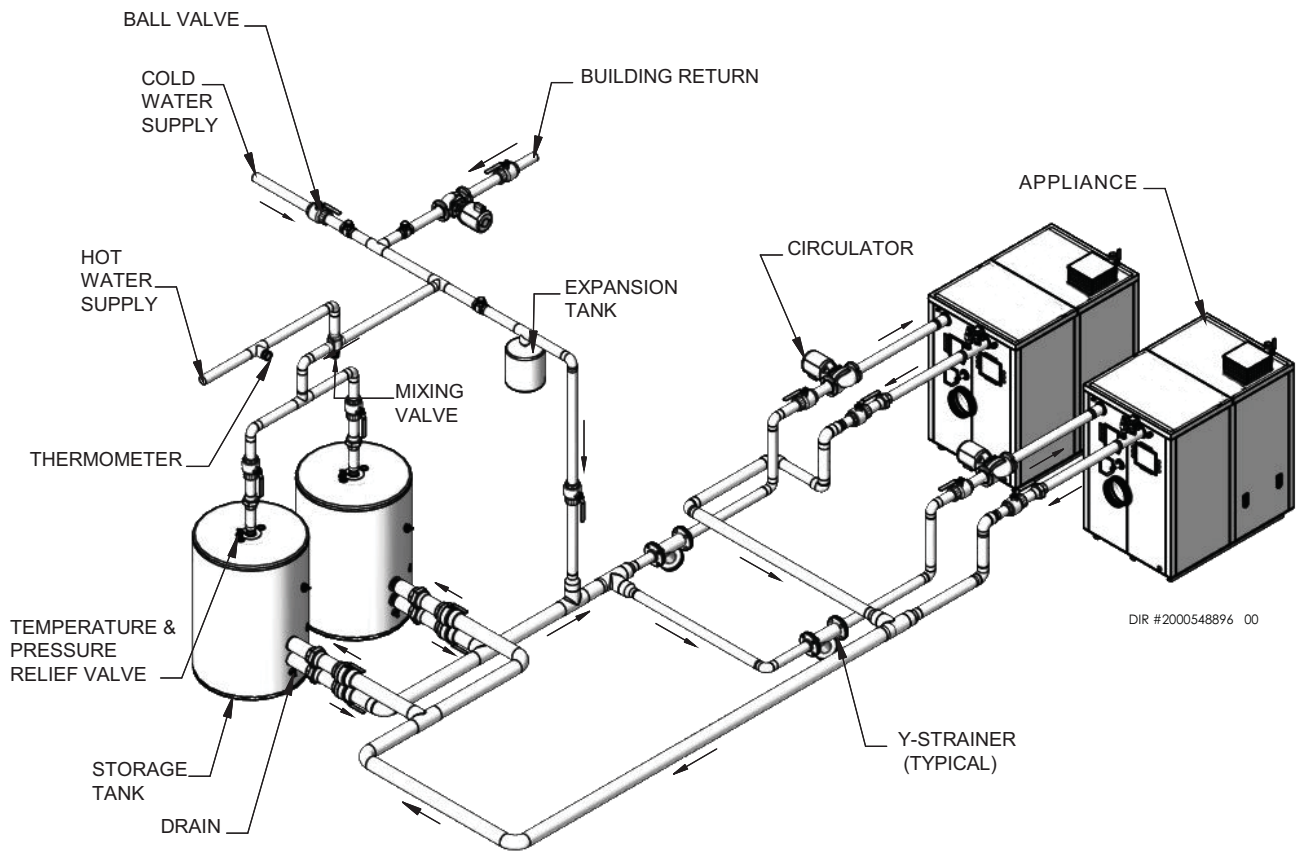

DIR #2000548896 00

CAUTION The piping will not support the weight of the appliance circulator pump. Do not attempt to support the weight of the appliance circulator pump with the piping or its accessories. Refer to the pump manufacturer’s installation instructions. Failure to comply could result in severe personal injury, death, or substantial property damage.

NOTICE Please note that these illustrations are meant to show system piping concept only, the installer is responsible for all equipment. The installer must follow all manufacturer’s instructions for each system component. The installer is responsible for compliance with local codes.