



## **COMMERCIAL ELECTRIC** - (2 UNITS)

<u>WARNING</u>: THIS DRAWING SHOWS SUGGESTED PIPING CONFIGURATION AND OTHER DEVICES; CHECK WITH LOCAL CODES AND ORDINANCES FOR ADDITIONAL REQUIREMENTS.

## **LEGEND**

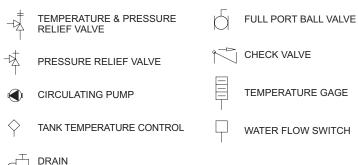

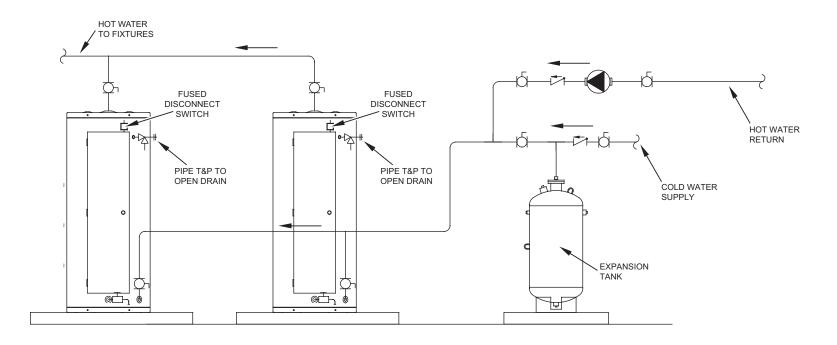

## NOTES:

- 1. Preferred piping diagram.
- 2. The temperature and pressure relief valve setting shall not exceed pressure rating of any component in the system.
- 3. Service valves are shown for servicing unit. However, local codes shall govern their usage.