

TX1 COMMERCIAL INTEGRATED TANKLESS ON TANK

The TX1 condensing water heater combines tankless with a tank to deliver energy saving performance.

INTEGRATED ACT-199 CONDENSING TANKLESS

- Delivers 96% thermal efficiency
- Modulating burner
- Heat exchanger constructed of commercial grade copper
- Secondary heat exchanger constructed of 316 grade stainless steel
- 185°F Max Temperature
- Available in natural gas or propane

119 GALLON STORAGE TANK

- PermaGlas® Ultra Coat™ liquid slush glass lining protects against corrosion
- Multiple anodes protect the tank
- Front water inlet and top water outlet
- High density foam reduces standby heat losses
- Heavy gauge steel jacket
- 160 psi working pressure

COMMERCIAL-GRADE COMPONENTS

- 4.1 GPM pump
- Advanced electronic control
- Factory installed T&P and pressure relief valves

CODES AND STANDARDS

- CSA certified and ASME rated T&P relief valve
- Maximum hydrostatic working pressure: 160 psi
- All models are design certified by Underwriters Laboratories (UL), Inc., to ANSI Z21.10.3 - CSA 4.3 Standards
- Meets the thermal efficiency and standby loss requirements of NRCan and current edition of ASHRAE/IES 90.1
- Design Certified by Underwriters Laboratories to NSF standard 5 for 180°F (62°C) water
- Complies with lead free standards

POWER DIRECT VENT DESIGN


- Exhaust, 3" venting up to 70 feet or 4" venting up to 100 feet
- Provides flexible venting with ULC S636, PVC, CPVC, or polypropylene pipe for intake and exhaust (solid core only)
- Category III or IV venting can be used

6 YEAR LIMITED HEAT EXCHANGER AND TANK, 5 YEAR LIMITED PARTS WARRANTY

- For complete warranty information, consult written warranty or go to hotwatercanada.ca

ATX-199 MODEL



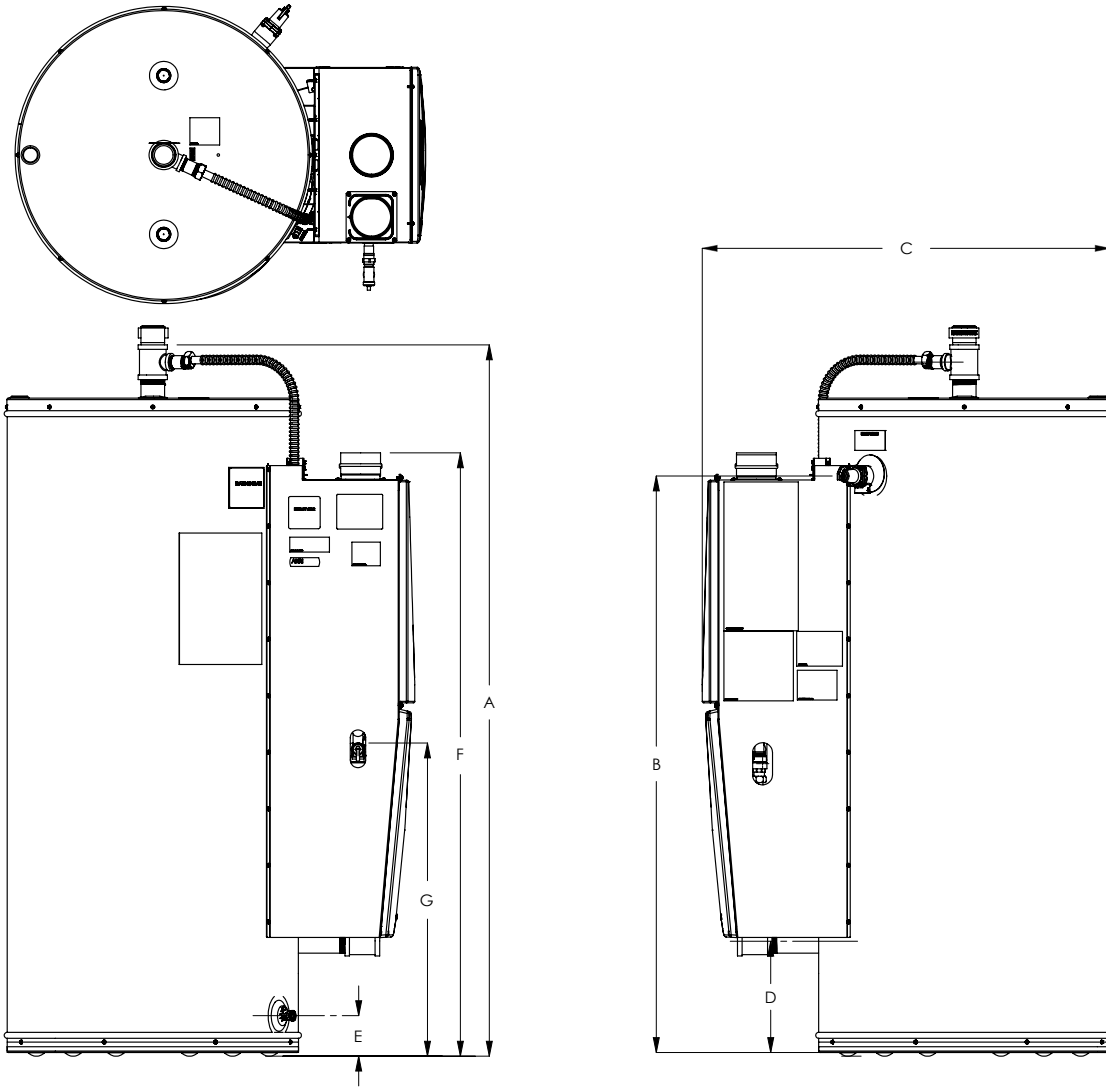

ATX-199

DIMENSIONS

DIMENSIONS							APPROX. SHIP WEIGHT
A	B	C	D	E	F	G	
Inches (cm)	Inches (cm)	Inches (cm)	Inches (cm)	Inches (cm)	Inches (cm)	Inches (cm)	LBS (KG)
72 (183)	59 (149)	41 (104)	12 (30)	4 (11)	61 (156)	30 (76)	520 (236)

Electrical characteristics-120V-60Hz A.C., 5.0 A

Dimensions and specifications subject to change without notice in accordance with our policy of continuous product improvement.

RECOVERY CAPACITIES

				U.S. GALLONS/HR & LITERS/HR AT TEMPERATURE RISE INDICATED												
TYPE OF GAS	INPUT		THERMAL EFFICIENCY%	°F	30°F	40°F	50°F	60°F	70°F	80°F	90°F	100°F	110°F	120°F	130°F	140°F
	BTU/h	kW		°C	17°C	22°C	28°C	33°C	39°C	44°C	50°C	56°C	61°C	67°C	72°C	78°C
Natural	199,000	58.32	96	GPH	772	579	463	386	331	289	257	232	211	193	178	165
Propane	199,000	58.32	96	LPH	2922	2192	1753	1461	1253	1094	973	878	799	731	674	625

STORAGE CAPACITY

MODEL NUMBER	U.S. GALLONS	LITERS
ATX-199-N	119	451
ATX-199-P	119	451

GAS PRESSURE REQUIREMENTS

MANIFOLD PRESSURE		MINIMUM SUPPLY PRESSURE		MAXIMUM SUPPLY PRESSURE	
NATURAL GAS	PROPANE GAS	NATURAL GAS	PROPANE GAS	NATURAL GAS	PROPANE GAS
2.95" W.C. (0.73 kPa)	3.3" W.C. (0.82 kPa)	4.0" W. C. (1.00 kPa)	8.0" W. C. (1.99 kPa)	10.5" W. C. (2.61 kPa)	14" W. C. (3.49 kPa)

SUGGESTED SPECIFICATION

(Natural or Propane) gas water heater(s) shall be A. O. Smith TX1 model # _____ or equal, minimum 96% thermal efficiency, a storage capacity of 119 gallons, an input rating of 199,000 BTUs per hour, a recovery rating of 232 gallons per hour (gph) at 100°F rise and a maximum hydrostatic working pressure of 160 psi. Water heater(s) shall: 1. Modulating gas burner that automatically adjusts the input based on demand. 2. Dual anodes. 3. Have seamless glass-lined steel tank construction, with glass lining applied to all water-side surfaces after the tank has been assembled and welded; 4. Meets the thermal efficiency and/or standby loss requirements of NRCAN and current edition of ASHRAE/IES 90.1; 5. Have foam insulation and a CSA Certified and ASME rated T&P relief valve; 6. Have a condensing tankless with modulating burner as the heat source; 7. Be approved for 0" clearance to combustibles.

The control shall be an integrated solid-state temperature and ignition control device with integral diagnostics, graphic user interface, fault history display, and shall have digital temperature readout. 1. All models are design certified by Underwriters Laboratories (UL), Inc., according to ANSI Z21.10.3 - CSA 4.3 standards governing storage type water heaters; 2. Meet the thermal efficiency and standby loss requirements of NRCAN and current edition of ASHRAE/IES 90.1; 3. Complies with NSF Low Lead Standard.

The heater(s) exhaust shall be vented with 3" or 4" diameter ULC S636 approved schedule 40 PVC, CPVC, polypropylene or Category III/IV vent pipe with a length not to exceed 70 ft. (equivalent) for 3" vent or 100 ft. (equivalent) for 4" vent, terminating horizontally or vertically. The intake pipe may use material such as PVC, ABS, polypropylene, aluminum, or Category III/ IV pipe and cannot exceed 70 ft. (equivalent) for 3" vent or 100 ft. (equivalent) for 4" vent.

Operation of the water heater(s) in a closed system where thermal expansion has not been compensated for (with a properly sized thermal expansion tank) will void the warranty.